

**Priority Areas Lead Testing and Corrective Action Child  
Development Center- Bldg 4477 2020 Test Results**

**Table 1. Summary of Results**

SAMPLE LOCATION DESCRIPTION				INITIAL FULL BUILDING SAMPLING RESULTS			RE-SAMPLING RESULTS			POST REMEDIATION SAMPLING RESULTS		CORRECTIVE ACTIONS
CATEGORY Water Intended For:	SAMPLE ID	Room	Outlet Description	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	Recommended Level = 15ppb				Description
								First Draw (ppb)	Follow up Flush Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	
<b>SAMPLING DATE</b>				9/30/2020			-	-	-	-	-	
<b>RESULTS DATE</b>				10/13/2020			-	-	-	-	-	
Drinking	YSK4477C001	113	Cooler	Non-Detect	No	-	-	-	-	-	-	-
Drinking	YSK4477C002	113	Cooler	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F001	116	Faucet	1.4	No	-	-	-	-	-	-	-
Washing	YSK4477F002	116	Faucet	0.68	No	-	-	-	-	-	-	-
Washing	YSK4477F003	116	Faucet	1.2	No	-	-	-	-	-	-	-
Washing	YSK4477F004	117	Faucet	0.56	No	-	-	-	-	-	-	-
Washing	YSK4477F005	117	Faucet	0.75	No	-	-	-	-	-	-	-
Washing	YSK4477F006	117	Faucet	0.98	No	-	-	-	-	-	-	-
Washing	YSK4477F007	118	Faucet	0.59	No	-	-	-	-	-	-	-
Washing	YSK4477F008	118	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F009	118	Faucet	0.92	No	-	-	-	-	-	-	-
Washing	YSK4477F010	119	Faucet	1.6	No	-	-	-	-	-	-	-
Washing	YSK4477F011	119	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F012	119	Faucet	0.9	No	-	-	-	-	-	-	-
Washing	YSK4477F013	120	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F014	120	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F015	120	Faucet	1.1	No	-	-	-	-	-	-	-
Washing	YSK4477F016	121	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F017	121	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F018	121	Faucet	1.4	No	-	-	-	-	-	-	-
Washing	YSK4477F019	125	Faucet	0.6	No	-	-	-	-	-	-	-
Washing	YSK4477F020	125	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F021	125	Faucet	0.87	No	-	-	-	-	-	-	-
Washing	YSK4477F022	125	Faucet	0.88	No	-	-	-	-	-	-	-
Washing	YSK4477F023	125	Faucet	0.7	No	-	-	-	-	-	-	-
Washing	YSK4477F024	126	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F025	126	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F026	126	Faucet	0.8	No	-	-	-	-	-	-	-
Washing	YSK4477F027	126	Faucet	0.77	No	-	-	-	-	-	-	-
Washing	YSK4477F028	126	Faucet	0.54	No	-	-	-	-	-	-	-
Washing	YSK4477F029	127	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F030	127	Faucet	1.1	No	-	-	-	-	-	-	-
Washing	YSK4477F031	127	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F032	127	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Cooking/Brushing	YSK4477F033	127	Faucet	3	No	-	-	-	-	-	-	-
Cooking/Brushing	YSK4477F034	127	Faucet	16	Yes	-	-	8.3	0.56	-	-	Flushed Outlet and resampled 10/16.
Washing	YSK4477F035	127	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F036	104	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F037	105	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F038	111	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F039	124	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F040	124	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F041	124	Faucet	Non-Detect	No	-	-	-	-	-	-	-
Washing	YSK4477F042	124	Faucet	0.84	No	-	-	-	-	-	-	-
Washing	YSK4477F043	124	Faucet	1.5	No	-	-	-	-	-	-	-
Washing	YSK4477F044	123	Faucet	Non-Detect	No	-	-	-	-	-	-	-

SAMPLE LOCATION DESCRIPTION				INITIAL FULL BUILDING SAMPLING RESULTS			RE-SAMPLING RESULTS				POST REMEDIATION SAMPLING RESULTS		CORRECTIVE ACTIONS
CATEGORY Water Intended For:	SAMPLE ID	Room	Outlet Description	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	Recommended Level = 15ppb					Description
								First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb)	
Washing	YSK4477F045	123	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-
Washing	YSK4477F046	123	Faucet	0.52	No	-	-	-	-	-	-	-	-
Washing	YSK4477F047	123	Faucet	0.77	No	-	-	-	-	-	-	-	-
Washing	YSK4477F048	123	Faucet	0.75	No	-	-	-	-	-	-	-	-
Washing	YSK4477F049	122	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-
Washing	YSK4477F050	122	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-
Washing	YSK4477F051	122	Faucet	1.5	No	-	-	-	-	-	-	-	-
Washing	YSK4477F052	122	Faucet	0.59	No	-	-	-	-	-	-	-	-
Washing	YSK4477F053	122	Faucet	0.56	No	-	-	-	-	-	-	-	-
Washing	YSK4477F054	112	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-
Washing	YSK4477F055	103	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-
Cooking/Brushing	YSK4477F056	127	Faucet	Non-Detect	No	-	-	-	-	-	-	-	-

Notes :

Table 2. Summary Statistics

CATEGORY	INITIAL SAMPLING		RE-SAMPLING RESULTS				POST REMEDIATION RESULTS	
	First Draw (ppb)	Water Fountain Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Recommended Level = 15 ppb		First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	
				Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)				
Total Drinking	2	0	0	0	0	0	0	
Total Drinking > 15 ppb	0	0	0	0	0	0	0	
Total Cooking/Brushing	3	0	1	1	1	0	0	
Total Cooking/Brushing > 15 ppb	1	0	0	0	0	0	0	
Total Washing	53	0	0	0	0	0	0	
Total Washing > 15 ppb	0	0	0	0	0	0	0	
Total Samples	58	0	1	1	1	0	0	
Total Samples > 15 ppb	1	0	0	0	0	0	0	


MARK	DATE	APPROV.

DESCRIPTION	DATE

DESIGNED BY: A.B.	CAD BY: T.M.	CONTRACT NO.:	DRAWING CODE:
DWG. BY: T.M.	ASST. TO A.B.	SUBMITTED BY:	FILE NAME:
U.S. ARMY CORPS OF ENGINEERS	JAPAN DISTRICT	YOKOSUKA RESIDENT OFFICE	FPO AP 98349-0016

PROJ. CHILD DEVELOPMENT CENTER COMMANDER/FLEET ACTIVITIES YOKOSUKA, JAPAN

ARCHITECTURAL BUILDING FLOOR PLAN

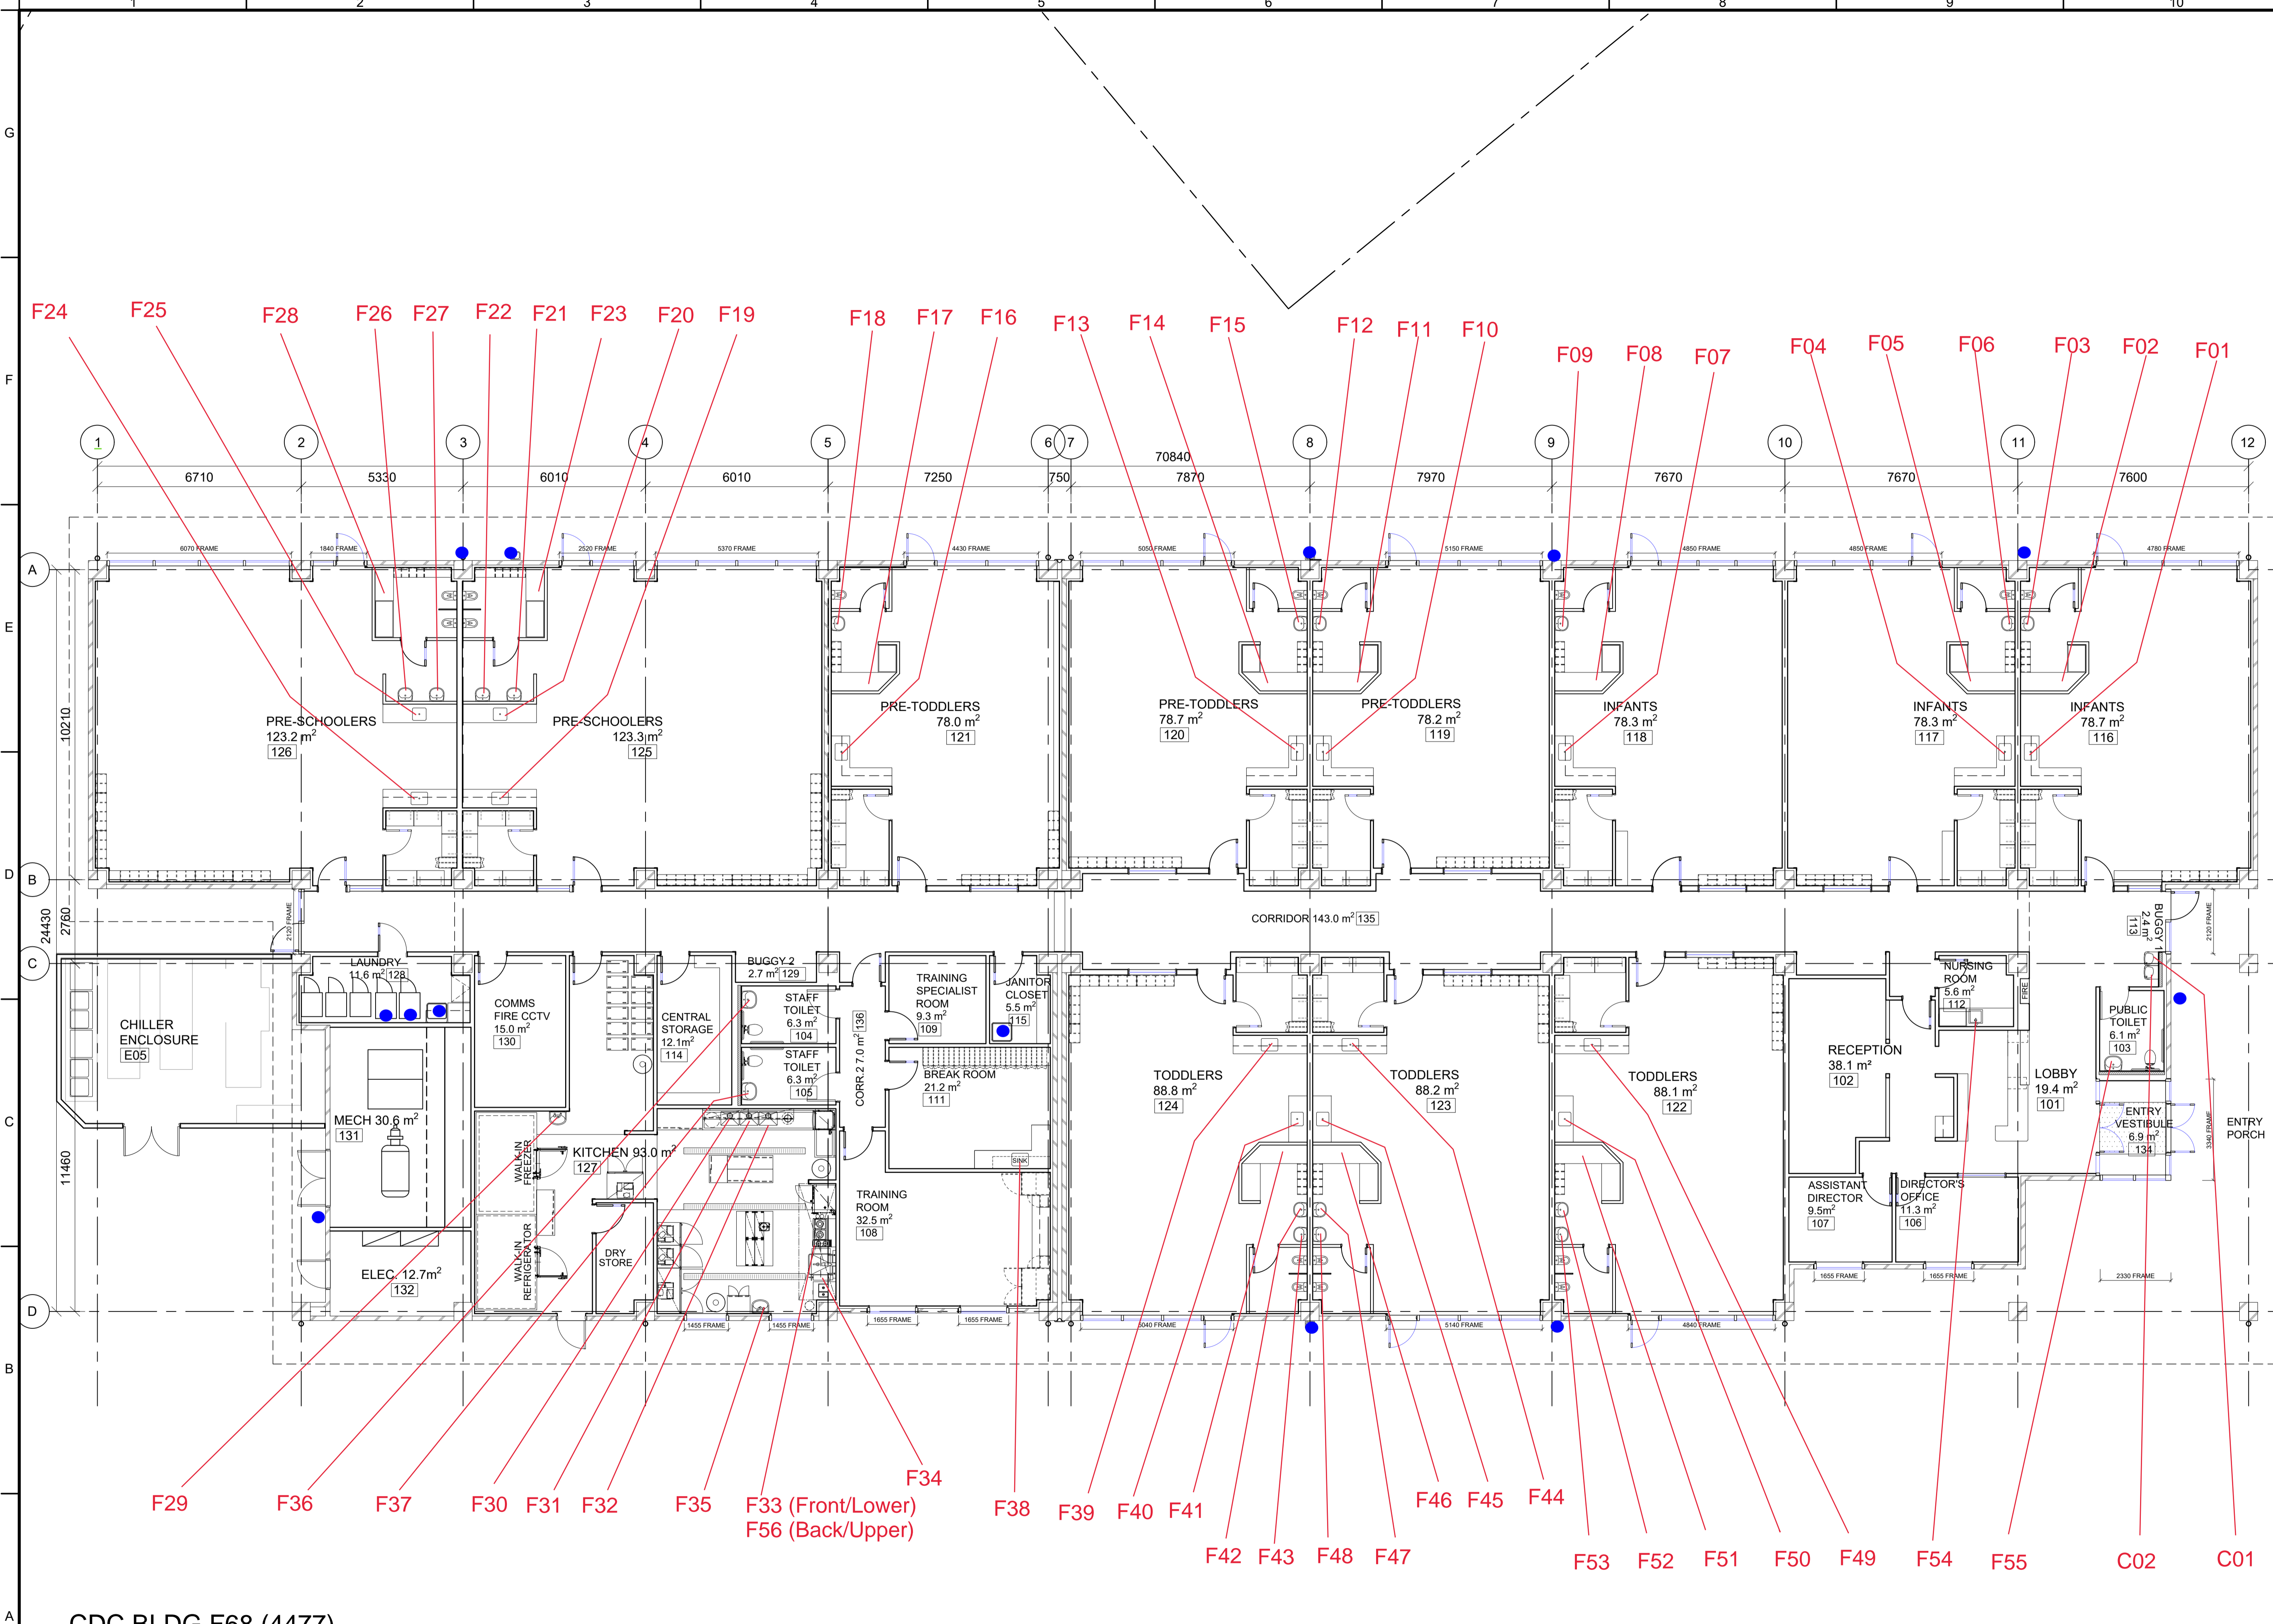

CDC BLDG F68 (4477)

● HOSEBIBBS, JANITOR DEEP SINK, LAUNDRY HOOK UPS

1 BUILDING FLOOR PLAN  
SCALE 1:100



NOTE: ALL DIMENSIONS SHOWN ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.